PHOTOSIMULATION 13: MOXIE POND - North, East Moxie Twp






Proposed Conditions: Panoramic view looking southwest to west from the northern end of Moxie Pond toward the proposed co-located HVDC transmission line. The existing 150' wide corridor clearing will be widened by 75' on the western side to accommodate the new transmission line. Three structures and conductors will be visible at distances of 2,400 to 2,900 feet from this viewpoint. Moxie Pond is a designated scenic resource with a 'Outstanding' rating in the Maine Wildlands Lake Assessment. See Appendix B: Study Area Photographs for images.





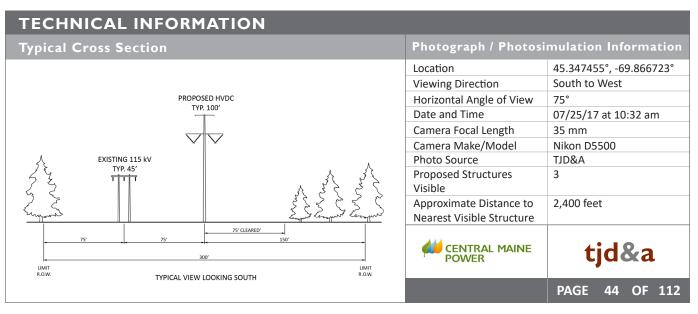

PHOTOSIMULATION 13A: MOXIE POND - North, East Moxie Twp





Existing Conditions: Normal view looking southwest from the northern area of Moxie Pond toward existing 115 kV transmission line. Mosquito Mountain is visible on the left side of the image.

September 27, 2017

PAGE 45 OF 112

PHOTOSIMULATION 13A: MOXIE POND - North, East Moxie Twp





Proposed Conditions: Normal view looking southwest from the northern area of Moxie Pond toward the proposed co-located HVDC transmission line. One structure and conductors will be visible from this viewpoint at a distance of 2,900 feet. The existing 150' wide corridor clearing will be widened by 75' on the western side to accommodate the new transmission line.

September 27, 2017

PAGE 46 OF 112

PHOTOSIMULATION 13B: MOXIE POND - North, East Moxie Twp



PAGE 47 OF 112



PHOTOSIMULATION 13B: MOXIE POND - North, East Moxie Twp





Proposed Conditions: Normal view looking southwest from the northern area of Moxie Pond toward the proposed co-located HVDC transmission line. One structure and conductors will be visible from this viewpoint at a distance of 2,400 feet. The existing 150' wide corridor clearing will be widened by 75' on the western side to accommodate the new transmission line.

September 27, 2017

PAGE 48 OF 112

PHOTOSIMULATION 14: MOXIE POND - North, East Moxie Twp






Proposed Conditions: Panoramic view looking west to northwest from the northern end of Moxie Pond toward the proposed co-located HVDC transmission line. The existing 150' wide corridor clearing will be widened by 75' on the western side to accommodate the new transmission line. Three structures and conductors will be visible at distances of 2,400 to 4,200 feet from this viewpoint. Moxie Pond is a designated scenic resource with a 'Outstanding' rating in the Maine Wildlands Lake Assessment.

See Appendix B: Study Area Photographs for images.





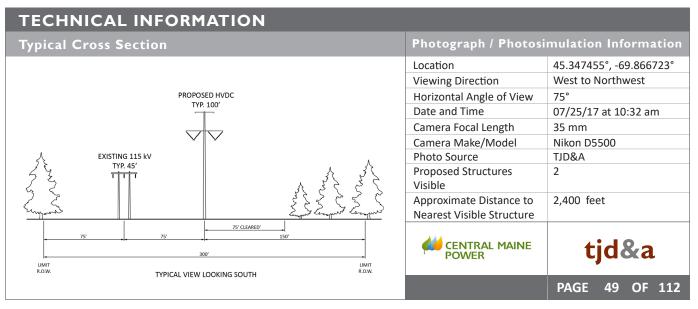

PHOTOSIMULATION 14A: MOXIE POND - North, East Moxie Twp





PAGE 50 OF 112

PHOTOSIMULATION 14A: MOXIE POND - North, East Moxie Twp





Proposed Conditions: Normal view looking west from the northern area of Moxie Pond toward the proposed co-located HVDC transmission line. Two structures and conductors will be visible from this viewpoint at a distance of 2,400 feet. The existing 150' wide corridor clearing will be widened by 75' on the western side to accommodate the new transmission line.

September 27, 2017

PAGE 51 OF 112

PHOTOSIMULATION 14B: MOXIE POND - North, East Moxie Twp





Existing Conditions: Normal view looking northwest from the northern area of Moxie Pond toward existing 115 kV transmission line. The boat launch at the north end of Moxie Pond and Coburn Mountain are visible on the right side of the image.

September 27, 2017

PAGE 52 OF 112

PHOTOSIMULATION 14B: MOXIE POND - North, East Moxie Twp






Proposed Conditions: Normal view looking southwest from the northern area of Moxie Pond toward the proposed co-located HVDC transmission line. One structure and conductors will be visible from this viewpoint at a distance of 4,200'. The existing 150' wide corridor clearing will be widened by 75' on the western side to accommodate the new transmission line.


PHOTOSIMULATION 15: MOXIE POND - South, Bald Mountain Twp T2 R3




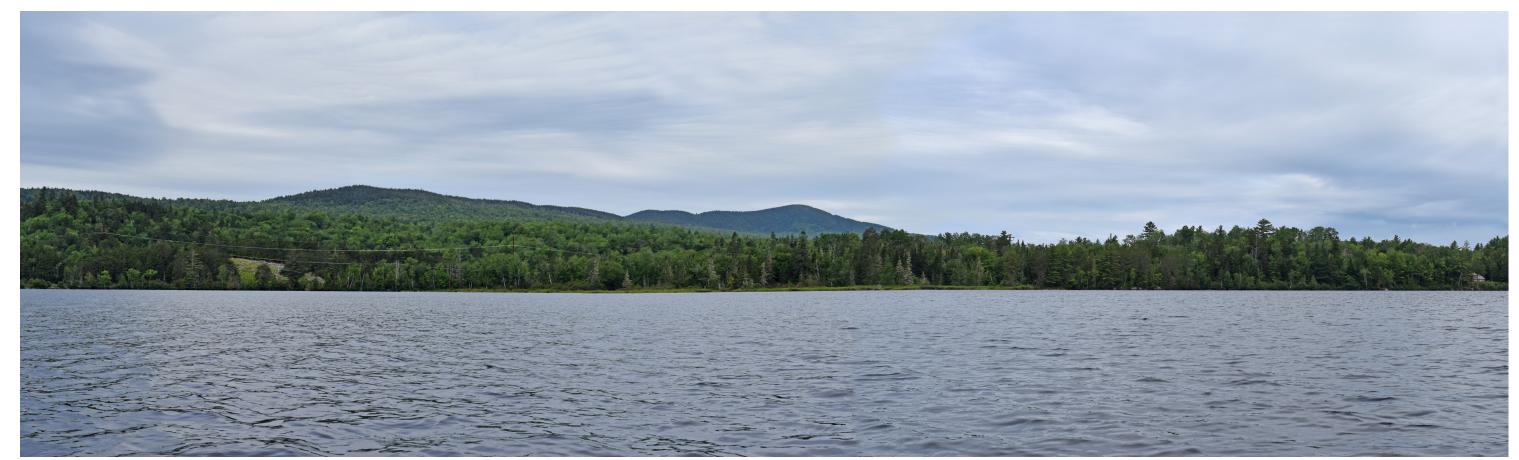

Proposed Conditions: Panoramic view looking from southwest to northwest from the southern area of Moxie Pond toward the proposed co-located HVDC transmission line. The clearing will be widened by 75' on the western side of the existing 150' wide 115 kV transmission line corridor to accommodate the new transmission line. Portions of the widened corridor will be visible in two areas of the pond where the existing corridor is already visible; at the southern end north of Joes Hole as shown in this image and near Black Narrows. The tops of up to three HVDC transmission line structures will be visible above the tree line from this viewpoint. The majority of the structures and conductors will be screened by shoreline vegetation. Moxie Pond is a designated scenic resource with an 'Outstanding' rating in the Maine Wildlands Lake Assessment. See Appendix B: Study Area Photographs for additional images.



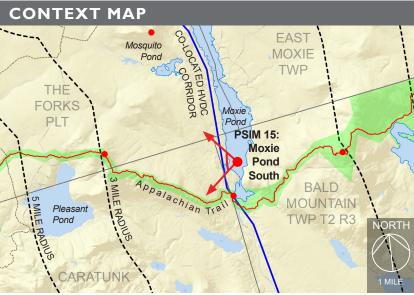

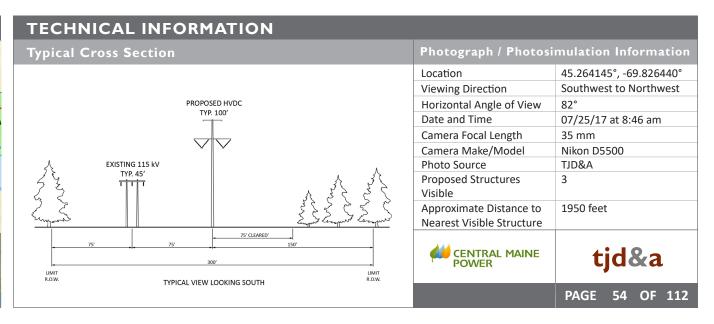

PHOTOSIMULATION 15A: MOXIE POND - South, Bald Mountain Twp T2 R3





PHOTOSIMULATION 15A: MOXIE POND - South, Bald Mountain Twp T2 R3





Proposed Conditions: Normal view looking west from the southern area of Moxie Pond toward the proposed co-located HVDC transmission line. The clearing will be widened by 75' on the western side of the existing 150' wide 115 kv transmission line corridor to accommodate the new HVDC transmission line. The top portion of three structures and the conductors will be visible above the existing transmission line structures & conductors.

September 27, 2017

PAGE 56 OF 112

PHOTOSIMULATION 15B: MOXIE POND - South, Bald Mountain Twp T2 R3



PAGE 57 OF 112



PHOTOSIMULATION 15B: MOXIE POND - South, Bald Mountain Twp T2 R3





Proposed Conditions: Normal view looking northwest from the southern area of Moxie Pond toward the proposed co-located transmission line. The change in vegetation due to the widening of the cleared corridor will not be noticeable looking in this direction. One structure and portions of conductors will be visible, but mostly screened by vegetation.

September 27, 2017

PAGE 58 OF 112

PHOTOSIMULATION 16: MOSQUITO MOUNTAIN - Overlook Looking Northeast, The Forks PLT






Proposed Conditions: Panoramic view looking north to east from the eastern overlook on Mosquito Mountain toward the proposed co-located HVDC transmission line. The existing 150' wide transmission line corridor clearing will be widened by 75' on the western side to accommodate the proposed HVDC transmission line. Seven structures and conductors will be visible within three miles of this viewpoint. Big Moose Mountain is visible in the center of the image with Black Narrows on the right side of the image. Moxie Pond is visible across the entire image. See Appendix B: Study Area Photographs for additional images.





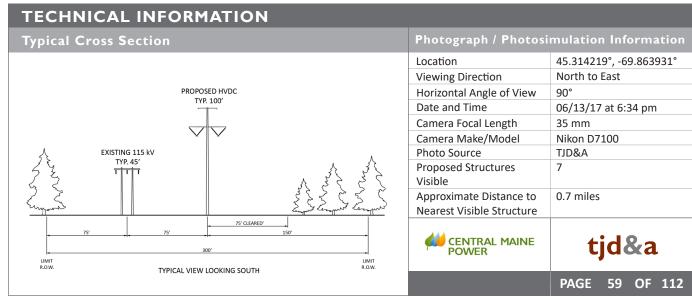

PHOTOSIMULATION 16A: MOSQUITO MOUNTAIN - Overlook Looking Northeast, The Forks PLT





Existing Conditions: Normal view looking north from Mosquito Mountain towards the existing 115 kV transmission line and the northern end of Moxie Pond. The existing transmission line corridor and Indian Pond Road to Harris Dam are visible on the left side of the image, north of Moxie Pond.

September 27, 2017
PAGE 60 OF 112

PHOTOSIMULATION 16A: MOSQUITO MOUNTAIN - Overlook Looking Northeast, The Forks PLT





Proposed Conditions: Normal view looking north from Mosquito Mountain toward the proposed co-located HVDC transmission line. The existing 150' wide transmission line corridor clearing will be widened by 75' on the western side to accommodate the proposed co-located HVDC transmission line. Three structures and conductors will be visible from this viewpoint at distances of 0.9 to 1.3 miles.

September 27, 2017
PAGE 61 OF 112

PHOTOSIMULATION 16B: MOSQUITO MOUNTAIN - Overlook Looking Northeast, The Forks PLT





Existing Conditions: Normal view looking northeast from Mosquito Mountain. Burnt Jacket Island in Moxie Pond is visible right of center in image. The existing 115 kV transmission line is mostly screened by vegetation in this view.

September 27, 2017

PAGE 62 OF 112

PHOTOSIMULATION 16B: MOSQUITO MOUNTAIN - Overlook Looking Northeast, The Forks PLT





Proposed Conditions: Normal view looking northeast from Mosquito Mountain toward the proposed co-located HVDC transmission line. The existing 150' wide transmission line corridor clearing will be widened by 75' on the western side to accommodate the proposed Co-located HVDC transmission line. Three structures and conductors will be visible from this viewpoint at distances of 0.7 to 0.9 miles.

September 27, 2017

PAGE 63 OF 112

PHOTOSIMULATION 16C: MOSQUITO MOUNTAIN - Overlook Looking Northeast, The Forks PLT





Existing Conditions: Normal view looking east from Mosquito Mountain. Moxie Pond is visible across the entire image with Black Narrows on right in image. The existing 115 kV transmission line and Troutdale Road are visible

September 27, 2017

PAGE 64 OF 112

PHOTOSIMULATION 16C: MOSQUITO MOUNTAIN - Overlook Looking Northeast, The Forks PLT





Proposed Conditions: Normal view looking east from Mosquito Mountain toward the proposed co-located HVDC transmission line. The existing 150' wide transmission line corridor clearing will be widened by 75' on the western side to accommodate the proposed co-located HVDC transmission line. Three structures and conductors will be visible from this viewpoint at distances of 0.7 to 0.75 miles.

September 27, 2017

PAGE 65 OF 112

PHOTOSIMULATION 17: MOSQUITO MOUNTAIN - Looking Southeast, The Forks Plt






Proposed Conditions: Continued panoramic view looking from east to south from the eastern overlook of Mosquito Mountain toward the proposed co-located HVDC transmission line (see Photosimulation 17 for view to northeast). The existing 150' wide transmission line corridor clearing will be widened by 75' on the western side to accommodate the proposed HVDC transmission line. Bald Mountain is visible in the center of the image. Mosquito Pond is visible on the right side of the image. Moxie Pond, from Black Narrows to the Southern end, is visible across the entire image. The Bingham Wind Project is visible to the east at 14.5 miles. Up to 13 structures, conductors, and portions of the cleared corridor will be visible from within 3 miles from this viewpoint. See Appendix B: Study Area Photographs for additional images.





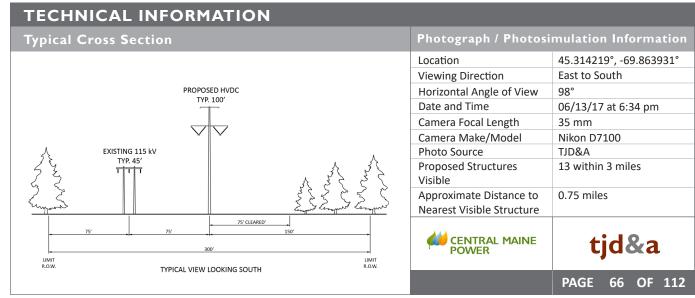

PHOTOSIMULATION 17A: MOSQUITO MOUNTAIN - Looking Southeast, The Forks Plt





Existing Conditions: Normal view looking east from Mosquito Mountain. Black Narrows in Moxie Pond is visible on the left side of the image. The existing 115 kV transmission line and Troutdale Road are visible

September 27, 2017

PAGE 67 OF 112

PHOTOSIMULATION 17A: MOSQUITO MOUNTAIN - Looking Southeast, The Forks Plt





Proposed Conditions: Normal view looking south from Mosquito Mountain toward the proposed co-located HVDC transmission line. The existing 150' wide transmission line corridor clearing will be widened by 75' on the western side to accommodate the proposed HVDC transmission line. Bald Mountain is visible in the center of the image. Mosquito Pond is visible on the right side of the image. Moxie Pond is visible across the entire image. The Bingham Wind Project is visible to the east. Three proposed structures and conductors will be visible at distances of 0.75 - 1.0 miles from this viewpoint.

September 27, 2017

PAGE 68 OF 112

PHOTOSIMULATION 17B: MOSQUITO MOUNTAIN - Looking Southeast, The Forks Plt





Existing Conditions: Normal view looking east from Mosquito Mountain. Bald Mountain North Peak is visible on the left side of the image, and Bald Mountain is visible on the right side of the image. Moxie Pond is visible across the entire image, with Mosquito Narrows on right in image.

September 27, 2017

PAGE 69 OF 112

PHOTOSIMULATION 17B: MOSQUITO MOUNTAIN - Overlook Looking Southeast, The Forks Plt





Proposed Conditions: Normal view looking southeast from Mosquito Mountain toward the proposed co-located HVDC transmission line. The existing 150' wide transmission line corridor clearing will be widened by 75' on the western side to accommodate the proposed HVDC transmission line. Six structures, conductors and portions of the cleared corridor will be visible at distances of 1.1 to 1.8 miles.

September 27, 2017

PAGE 70 OF 112

PHOTOSIMULATION 17C: MOSQUITO MOUNTAIN - Looking Southeast, The Forks Plt





Existing Conditions: Normal view looking southeast from Mosquito Mountain . Bald Mountain is visible on the left side of the image. The southern Moxie Pond is visible across the middle of image and Mosquito Pond is visible below in foreground. The Bingham Wind Project is visible 14.5 to 16.6 miles to the southeast.

September 27, 2017

PAGE 71 OF 112

PHOTOSIMULATION 17C: MOSQUITO MOUNTAIN - Looking Southeast, The Forks Plt





Proposed Conditions: Normal view looking southeast from Mosquito Mountain toward the proposed transmission line. The existing 150' wide transmission line corridor clearing will be widened by 75' on the western side to accommodate the proposed HVDC transmission line. Six structures and conductors and portions of the cleared corridor will be visible within three miles.

September 27, 2017
PAGE 72 OF 112

PHOTOSIMULATION 18:TROUTDALE ROAD, The Forks Plt.






Proposed Conditions: Panoramic view looking southeast to south from Troutdale Road in The Forks Plt. toward the proposed co-located HVDC transmission line. Troutdale Road is located within the existing 115 kV transmission line corridor for approximately 1,000 feet. The existing 150' wide corridor clearing will be widened by 75' on the western side to accommodate the new transmission structures will be visible looking to the southeast, and four looking to the northwest. See Appendix B: Study Area Photographs for additional images.





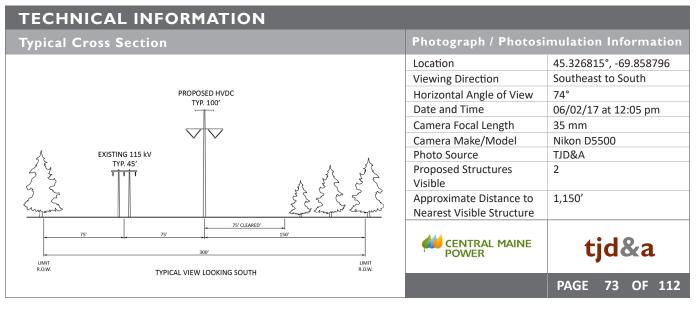

PHOTOSIMULATION 18A:TROUTDALE ROAD, The Forks Plt





Existing Conditions: Normal view looking southeast from Troutdale Road toward the existing 115 kV transmission line within a 150' wide cleared corridor.

September 27, 2017

PAGE 74 OF 112

PHOTOSIMULATION 18A:TROUTDALE ROAD, The Forks Plt





Proposed Conditions: Normal view looking southeast from Troutdale Road toward the proposed co-located HVDC transmission line. The existing 150' wide corridor clearing will be widened by 75' on the western side to accommodate the new transmission line. Two HVDC transmission structures will be visible looking to the southeast.

September 27, 2017
PAGE 75 OF 112


PHOTOSIMULATION 19: ROUTE 201, Moscow






Proposed Conditions: Panoramic view looking from northeast to east from Route 201 in Moscow toward the proposed co-located HVDC transmission line. The Wyman Hydro Electric Facility is visible in the opposite direction of this viewpoint. The existing 225' wide corridor clearing will be widened by 75' on the western side (left of corridor in image) to accommodate the proposed HVDC transmission line. Three structures will be visible from this viewpoint. See Appendix B: Study Area Photographs for additional images.



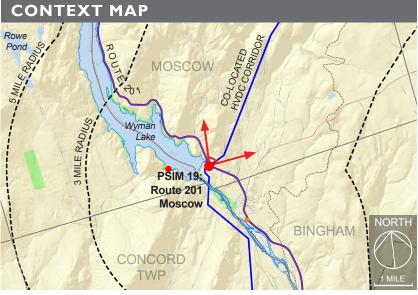

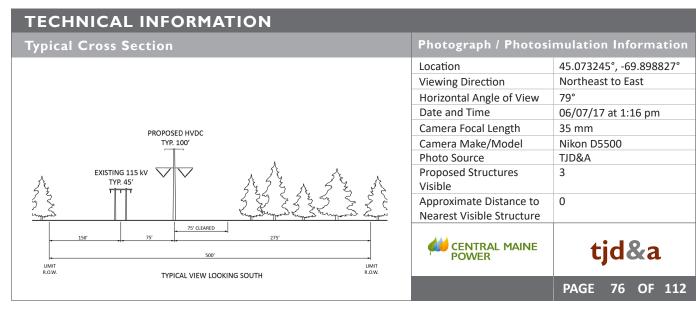

PHOTOSIMULATION 19A: ROUTE 201, Moscow





Existing Conditions: Normal view looking east from Route 201 toward the existing 115 kV transmission line corridor.

September 27, 2017

PAGE 77 OF 112

PHOTOSIMULATION 19A: ROUTE 201, Moscow





Proposed Conditions: Normal view looking east from Route 201 in Moscow toward the proposed co-located HVDC transmission line. The existing 225' wide corridor clearing will be widened by 75' on the western side (left of corridor in image) to accommodate the proposed HVDC transmission line. Three structures will be visible from this viewpoint.


September 27, 2017
PAGE 78 OF 112


PHOTOSIMULATION 20: WYMAN LAKE RECREATION AREA, Pleasant Ridge Plt






Proposed Conditions: Panoramic view looking from northeast to southeast from the Wyman Lake Recreation Area toward the proposed co-located HVDC transmission line. The proposed HVDC transmission line would be visible adjacent to the existing 115 kV transmission line and seen in context with the Wyman Hydro Dam and portions of six Bingham Wind turbines. Three HVDC transmission structures and conductors will be visible at distances of 0.9 - 1.3 miles from this viewpoint. See Appendix B: Study Area Photographs for additional images.

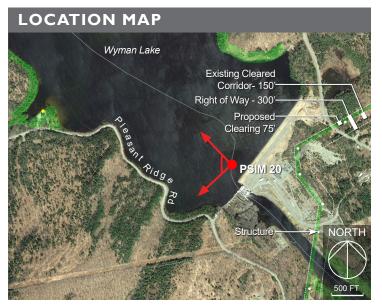

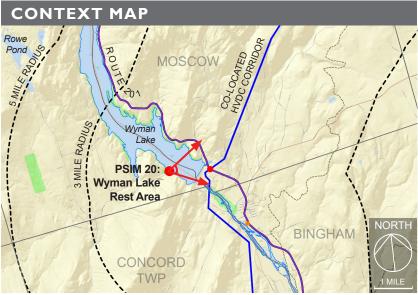

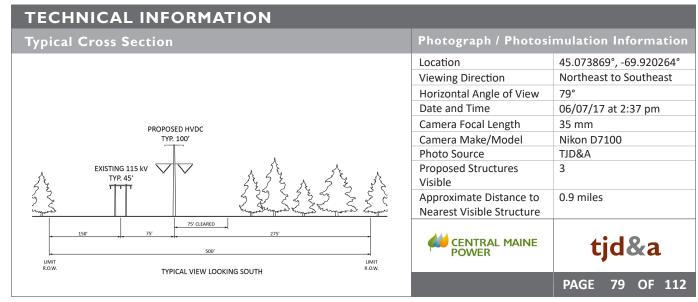

PHOTOSIMULATION 20A:WYMAN LAKE RECREATION AREA, Pleasant Ridge Plt





Existing Conditions: Normal view looking east from the Wyman Lake Recreation Area towards the Wyman Hydro Dam.

September 27, 2017

PAGE 80 OF 112

PHOTOSIMULATION 20A: WYMAN LAKE REST AREA, Pleasant Ridge Plt





Proposed Conditions: Normal view looking east from the Wyman Lake Recreation Area toward the proposed co-located HVDC transmission line. The proposed HVDC transmission line would be visible adjacent to the existing 115 kv transmission line and seen in context with the Wyman Hydro Dam and portions of six Bingham Wind turbines. Three structures, conductors, and portions of the cleared corridor will be visible at distances of 0.9 - 1.3 miles from this viewpoint.

September 27, 2017


PAGE 81 OF 112


PHOTOSIMULATION 21: ROUTE 8, Anson






Proposed Conditions: Panoramic view looking from north to east from Route 8 (Solon Rd) toward the proposed co-located HVDC transmission line. The existing 150' wide cleared corridor will be widened by 75' on the western side to accommodate the HVDC transmission line. Three of the proposed HVDC structures and conductors will be visible from this viewpoint. See Appendix B: Study Area Photographs for additional images.

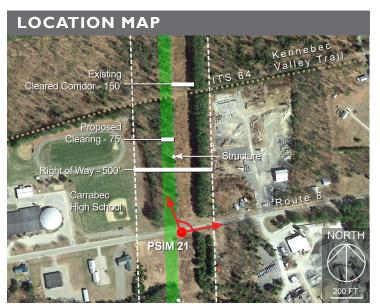

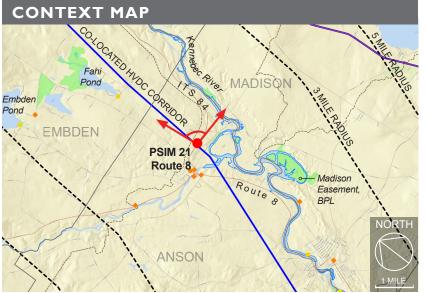

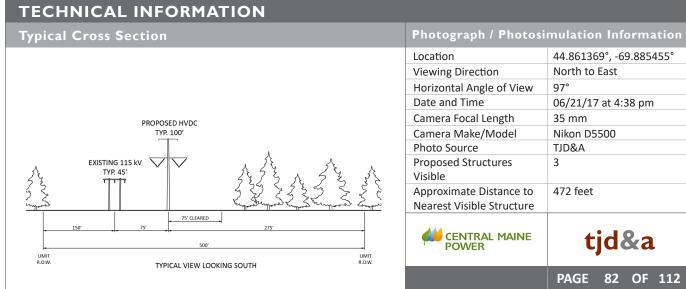

PHOTOSIMULATION 21A: ROUTE 8, Anson





Existing Conditions: Normal view looking north from Route 8 (Solon Rd) at the existing 115 kV transmission line.

September 27, 2017

PAGE 83 OF 112

PHOTOSIMULATION 21A: ROUTE 8, Anson





Proposed Conditions: Normal view looking north from Route 8 (Solon Rd) toward the proposed co-located HVDC transmission line. The existing 150' wide cleared corridor will be widened by 75' on the western side to accommodate the proposed HVDC transmission line. Three of the proposed HVDC structures and conductors will be visible from this viewpoint.

September 27, 2017
PAGE 84 OF 112

PHOTOSIMULATION 22: ROUTE 2, Farmington







Proposed Conditions: Panoramic view looking from south to west from Route 2 in Farmington toward the proposed co-located HVDC transmission line. The existing 225' wide cleared corridor will be widened by 75' on the western side to accommodate the proposed HVDC transmission line. Six of the proposed HVDC structures and conductors will be visible from this viewpoint.

See Appendix B: Study Area photographs for additional images.



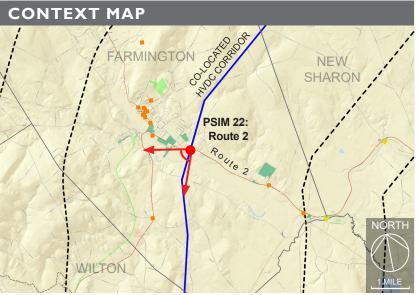

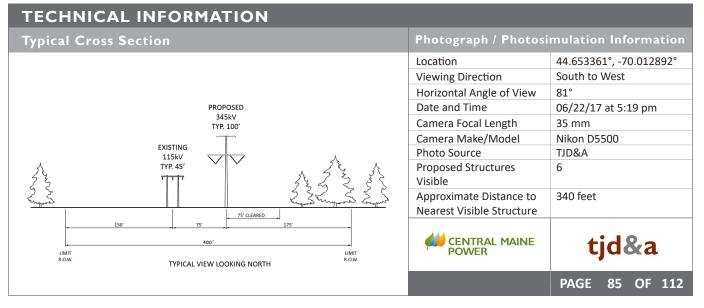

PHOTOSIMULATION 23A: ROUTE 2, Farmington





Existing Conditions: Normal view looking from southwest from Route 2 toward the existing 115 kV transmission line.

September 27, 2017

PAGE 86 OF 112

PHOTOSIMULATION 23A: ROUTE 2, Farmington





Proposed Conditions: Normal view looking from southwest from Route 2 toward the proposed co-located HVDC transmission line. The existing 225' wide cleared corridor will be widened by 75' on the western side to accommodate the new HVDC transmission line. Six of the proposed HVDC structures and conductors will be visible from this viewpoint.


September 27, 2017
PAGE 87 OF 112


PHOTOSIMULATION 23: ANDROSCOGGIN RIVERLANDS STATE PARK, Existing Transmission Line, Leeds






Proposed Conditions: Panoramic view looking from southeast to southwest from an access road crossing the existing transmission line within the Androscoggin Riverlands State Park toward the proposed co-located HVDC transmission line. The existing 225' corridor clearing will be widened by 75' on the western side to accommodate the new transmission line. See Appendix B: Study Area Photographs for additional images of the State Park.

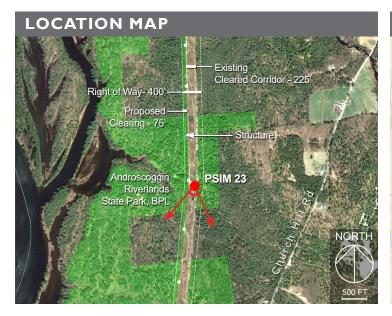

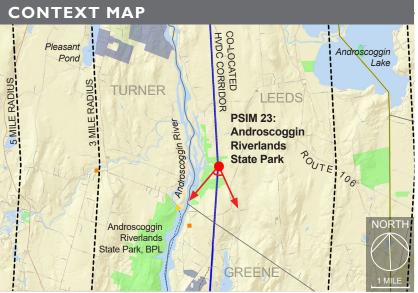

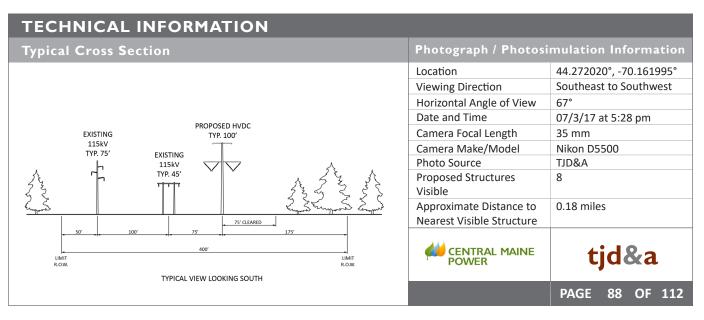

PHOTOSIMULATION 23A: ANDROSCOGGIN RIVERLANDS STATE PARK, Existing Transmission Line, Leeds





Existing Conditions: Normal view looking south from an access road within the Androscoggin Riverlands State Park crossing the existing transmission line.

September 27, 2017

PAGE 89 OF 112

PHOTOSIMULATION 23A: ANDROSCOGGIN RIVERLANDS STATE PARK, Existing Transmission Line, Leeds





Proposed Conditions: Normal view looking south from an access road (off Church Hill Road) crossing the existing transmission line within the State Park toward the proposed co-located HVDC transmission line. The existing 225' corridor clearing will be widened by 75' on the western side to accommodate the new transmission line.

September 27, 2017

PAGE 90 OF 112

PHOTOSIMULATION 24: MERRILL ROAD, Lewiston






Proposed Conditions: Panoramic view looking from north to northeast from Merrill Road toward the proposed Merrill Road Converter Station and co-located HVDC transmission line. The Converter Substation will be located approximately 2,400 feet north of Merrill Road and screened from view by the existing vegetation on the east side of the corridor to remain. The cleared corridor will be widened by 75' on the west side, (left side of corridor in image), to accommodate the proposed 345 kV to +/- 320 kV transmission line connection to the Larabee Substation, located south of this viewpoint. A 20' wide gravel access road, gate, and grassed lined stormwater facility will be visible from Merrill Road, but screened from view by vegetation from this viewpoint.

See Appendix B: Study Area Photographs for additional images.





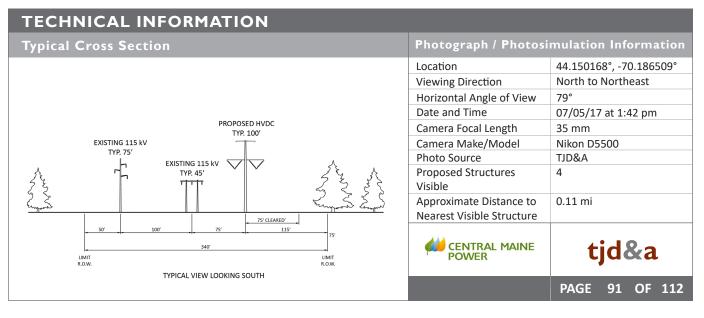

PHOTOSIMULATION 24A: MERRILL ROAD, Lewiston





Existing Conditions: Normal view looking from north from Merrill Road.

September 27, 2017

PAGE 92 OF 112

PHOTOSIMULATION 24A: MERRILL ROAD, Lewiston





Proposed Conditions: Normal view looking from north from Merrill Road toward the proposed Merrill Road Converter Station and co-located HVDC transmission line. The cleared corridor will be widened by 75' on the west side, (left side of corridor in image), to accommodate the proposed 345 kV to +/- 320 kV transmission line connection to the Larabee Substation, located south of this viewpoint.

September 27, 2017
PAGE 93 OF 112